

Unlock your boiler's potential


Control more with software unlocks


Access codes unlock advanced features without the inconvenience of hardware changes or added modules:

- Autoflame water level management
- Analogue water level (requires Autoflame water level)
- TDS/Top blowdown
- Bottom blowdown
- Draught control
- Direct Modbus connectivity
- First out annunciation
- Fully metered, cross-limited control
- ✓ Steam flow & water flow metering

The Mk8 MM Controller is a Micro-Modulating system that offers comprehensive control over industrial and commercial boiler/burners.

- Manage virtually all boiler processes from a single 12.1" multi-touch screen interface without any added modules.
- Ideal for steam and water boilers (watertube or firetube), kilns and steam generators. Designed for oil, natural gas or dual fuels.
- Linkageless servomotor system and automated flame safeguard create conditions for unmanned boilerhouse.
- Modbus connectivity allows for remote monitoring and management.

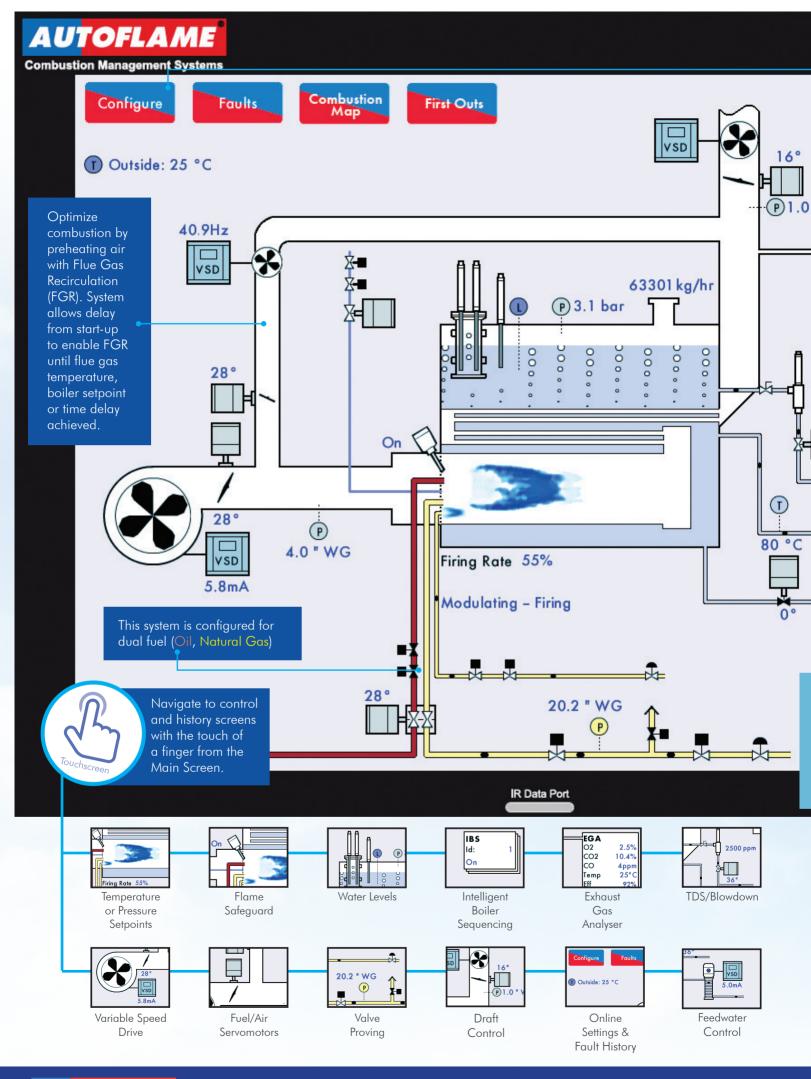


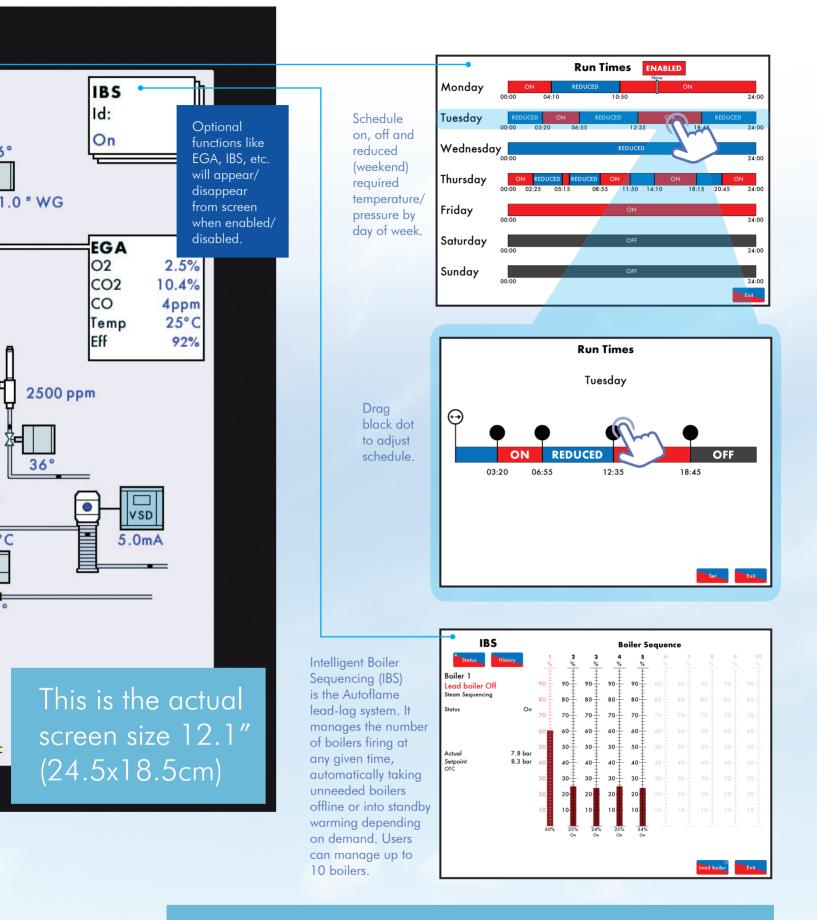


Schedule the boiler plant to run when & how you need it.

C	Options	Parameters	Expansion					
#	Descri	ption				Value		
1	MM: Bo	oiler Temperatu	re/Pressure S	ensor Typ	e	Medium pressure		
2 MM: Modulating Motor Travel Speed Limit					1.5			
3	Unused	: Option 3				(
4	Unused	: Option 4				(
5	MM: Pu	rge Position				Channels 1 to 4 purge at OPEN position		
6	PID: Pro	portional Band				1.0 ba		
7	PID: Int	egral Time				60 second		
8	MM: Servomotor Channels Channels 1 & 2							
9	MM: Internal Stat Operation Burner operates							
10	MM: Burner Switch-Off Offset					0.3 ba		
11	MM: Burner Switch-On Offset					0.3 ba		
12	EGA: EGA Functionality Not option							
13	EGA: EGA Fault Response					EGA faults generate Alarms (Burner stops		
14	MM: Warning Response					Warnings drive Common System Alarm output (179		
15	MM: U	er Control				Burner on/off and setpoint control enabled		
16	DTI: Se	quencing and D)TI enable			Sequencing disable		
17	Unused	: Option 17				(
18	EGA: C	arry Forward o	f Trim			Enabled		
19	EGA: C	2 Upper Limit	Offset			Disablea		
						_		
		MM PID	EGA	DTI	BC			


Options and parameters that are not safety related can be adjusted, providing a sophisticated level of customisation. All of these are viewable while the boiler is online. Some can be set while the burner is running, ensuring minimum boiler downtime.

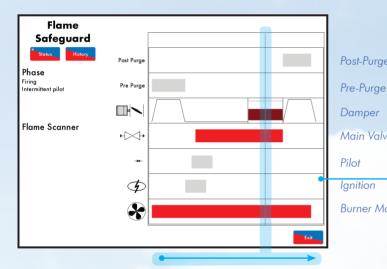


Flame Safeguard monitors & manages every stage of burner startup, including valve proving & IR/UV testing. Dotted vertical line slides right as the system advances through burner sequence.

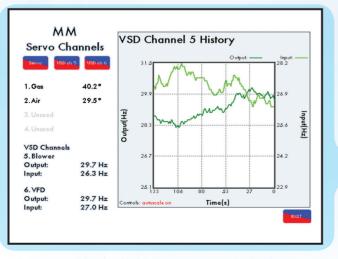

Focus on individual VSD or servomotor/valve history.

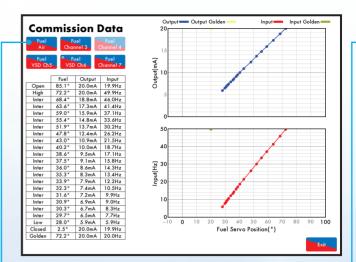


An engineer can quickly access commissioning data and modify Inter points during maintenance, reducing downtime.

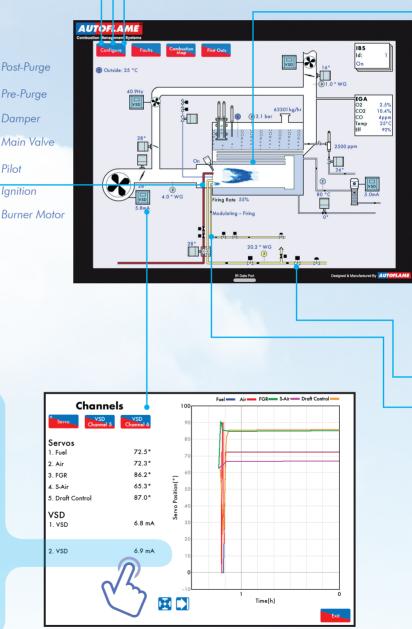



4 servomotors and 2 VSDs provide accurate and repeatable control of valves and dampers. 24 hour on-screen history enables immediate troubleshooting and optimising.

Lockouts	Phase	Occurred	Reset
1. VPS air proving fail	VPS Air Proving	14 Dec 15 12:21	14 Dec 15 12:21
2. VPS air zeroing	VPS Air Proving	14 Dec 15 12:21	14 Dec 15 12:21
3. Gas pressure low limit	VPS Gas Proving	14 Dec 15 12:19	14 Dec 15 12:19
4. VPS air zeroing	VPS Air Proving	14 Dec 15 11:43	14 Dec 15 11:43
5. Air Sensor Comms	Recycle	14 Dec 15 11:35	14 Dec 15 11:37
6. Air Sensor Comms	Recycle	14 Dec 15 09:49	14 Dec 15 11:18
7. Air Sensor Comms	Recycle	14 Dec 15 09:49	14 Dec 15 09:49
8. Air Sensor Comms	Recycle	11 Dec 15 11:52	11 Dec 15 12:18
9. Air Sensor Comms	Recycle	11 Dec 15 11:51	11 Dec 15 11:52
10. Air Sensor Comms	Recycle	11 Dec 15 11:51	11 Dec 15 11:51
11. Air Sensor Comms	Recycle	11 Dec 15 11:42	11 Dec 15 11:48
12. Air Sensor Comms	Recycle	11 Dec 15 11:40	11 Dec 15 11:42
13. Air Sensor Comms	Recycle	11 Dec 15 11:40	11 Dec 15 11:40
14. Air Sensor Comms	Recycle	11 Dec 15 11:40	11 Dec 15 11:40
15. Air Sensor Comms	Recycle	11 Dec 15 09:33	11 Dec 15 10:06
16. Air Sensor Comms	Recycle	11 Dec 15 09:33	11 Dec 15 09:33
17. Air Sensor Comms	Recycle	10 Dec 15 16:21	10 Dec 15 16:22
18. Wait Air Switch timeout	Wait Air Switch	10 Dec 15 12:07	10 Dec 15 12:54
19. No air proving	Purge	10 Dec 15 10:04	10 Dec 15 10:04
20. VPS air zeroing	VPS Air Proving	10 Dec 15 09:53	10 Dec 15 10:03
21. VPS air zeroing	VPS Air Proving	10 Dec 15 09:51	10 Dec 15 09:53
22. VPS air zeroing	VPS Air Proving	10 Dec 15 09:39	10 Dec 15 09:51


Error and Lockout logs allow engineers to view a history of burner operation to aid in troubleshooting. View the most recent 128 errors and lockouts.

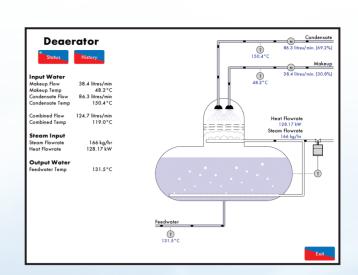




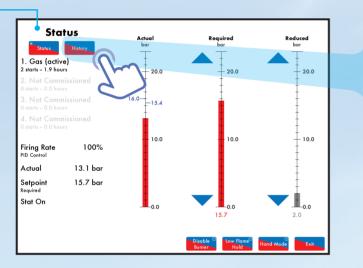


Easily change target setpoints for both the Required setpoints (for general ouput) & the Reduced setpoints (for when less steam or hot water is needed).

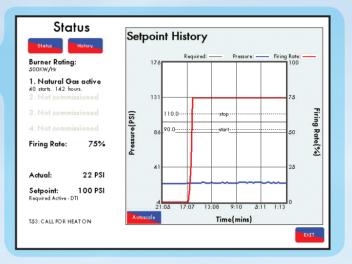

Quickly access boiler firing history and pressure or temperature history.

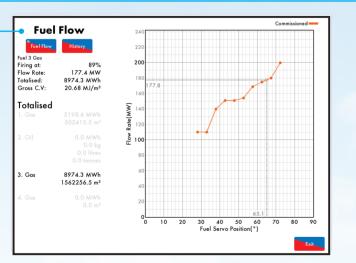

Enable fuel flow metering for the boiler without the cost of an external meter.

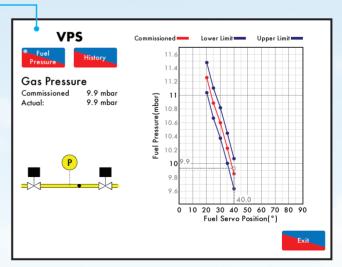



The Valve Proving System (VPS) tests the main gas valves to ensure seal integrity and safety.

Water Level Control

Problem: Inadequate water levels in the boiler can create very unsafe conditions. Solution: System safety is guaranteed as water level measurement is managed by two identical capacitance probes, both of which measure and control to the level switching points entered at the time of commissioning. The probes support up to 6 switch points (High level, 1st Low Level, 2nd Low Level, etc). The points trigger feedwater activation, alarms or lockouts, depending on commissioning.

Problem: Traditional water level management is not integrated with burner operation. This leads to inefficiency and suboptimal operation. Solution: The Mk8 manages the boiler comprehensively, coordinating water levels, burner operation and steam pressure, to create the ideal scenario for fuel savings and emission reduction.

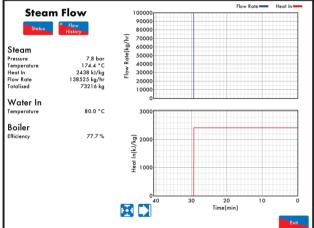

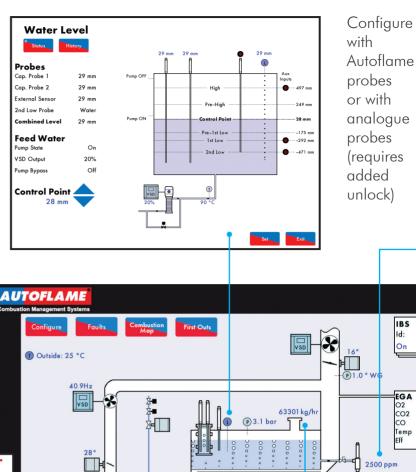

Firina Rate 55%

odulating – Firing

20.2 " WG

P

1

(P) 4.0 " WG 2.5%

10.4%

4ppn 25°(

92

ed By

2-36°


Ţ

Steam/Heat Flow Metering

Problem: Adding a traditional steam or heat flow meter involves a great deal of costly modifications to a boiler plant, including cutting, welding, wiring and installation of a water or steam flow meter.

Solution: Adding steam or heat flow metering to a Mk8 is as simple as optioning it in. Additional sensors increase accuracy. Once enabled, user has access to:

- Instantaneous steam & heat flow
- Gross/Net heat flow in the boiler calculated & displayed
- 24 hours of logged heat flow stored internally
- 2 years of heat flow data available on the Mk7 DTI
- Online analysis including instantaneous/totalised values, data logging & graphical display on the MM Controller & DTI
- Displayed in lbs/hr or kgs/hr

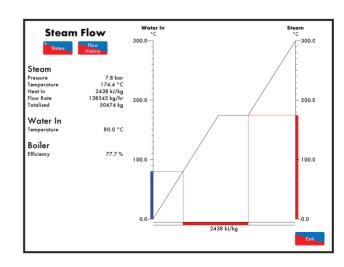


TDS/Top Blowdown


Problem: Total Dissolved Solids (TDS) are undesirable particles that naturally build up in boiler water. Ignored TDS results in scaling, rust and a variety of other problems that lead to poor performance and boiler failure.

Solution: Autoflame's TDS Management System drains water near the surface (Top Blowdown) based on TDS readings from a probe. It continues to drain water (which is then refilled by a feedwater valve) until the probe determines that the water has reached prescribed TDS levels. The engineer can also choose to set Top Blowdown at timed intervals instead.

Key benefits:

- Prevents corrosion & scaling
- Improves boiler performance, safety & longevity

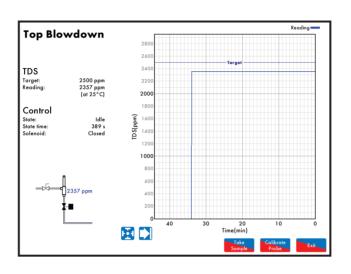




Bottom Blowdown


Problem: Conventional Bottom Blowdown methods can result in a loss of up to 3% in steam generation and may need the use of external air supply.


Solution: Autoflame's fully automatic Bottom Blowdown system with time reduction feature to minimise the losses which occur when keeping the boiler's heat transfer surface clean. Blowdown time can be reduced as a function of the rate of steam generation.

Key benefits:

- Fuel savings in the region of 1-2% are possible
- Blowdown timing automatically reduced in ratio to steam generation
- Blowdown timings set by users
- Operators may only trigger pre-set timings, eliminates excessive blowdown by operator
- Ensures minimal blowdown to satisfy removal of solids, silt and sludge

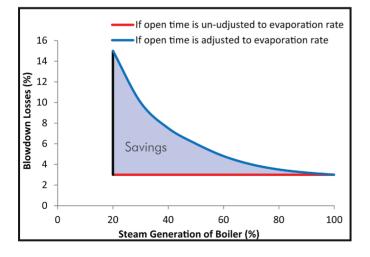

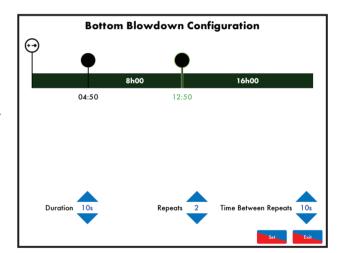

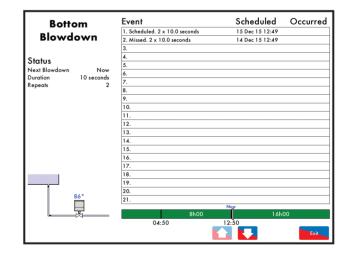

Options	Parameters	Expansion							
# Descri	otion	L						Value	
140 FM: Fully Metered Function						Enabled			
141 FM: Fue	Flow Meter T	ype			Volume Flow Meter (With square root extraction				
142 FM: Fue	Flow Meter S	caling			800 m³/hr at 20mA inpu				
143 FM: Air	Flow Meter Ty	pe			Volum	Volume Flow Meter (With square root extraction			
144 FM: Air	Flow Meter Sc	aling				10000 m³/hr at 20mA inpu			
145 FM: Fue	Temperature	Sensor Enable				Enable			
146 FM: Air	Temperature S	ensor Enable	-	-		-		Enabled	
147 FM: Fue	Pressure Sens	or Enable				Enable			
148 FM: Air Pressure Sensor Enable						Enable			
149 FM: Maximum Fuel Channel Compensation						10.0 %			
150 FM: Maximum Air Channel Compensation					10.0 %				
151 FM: Action on Air Adjustment Failure					Generate Warnin				
152 FM: Action on Flow Meter Failure Generate War						te Warning			
153 FM: De	ault absolute a	mbient air pres	sure					1013 mba	
154 FM: Fue	1 Density					0	.656 kg/m ³ @ 1013.25	mbar 15°C	
155 FM: Fue	2 Density					0	.680 kg/m ³ @ 1013.25	mbar 15°C	
156 FM: Fue	3 Density				0.656 kg/m³ @ 1013.25mbar 15°				
157 FM: Fue	157 FM: Fuel 4 Density				0.800 kg/m³ @ 1013.25mbar 15°				
All WI	C TBD	BBD DC	Modbus	FO	Flow	FM		Exit	

Fully Metered, Cross-Limited • Combustion Control


In many burner applications such as dryers, kilns and furnaces, monitoring stack emissions to commission and implement trim is simply not possible. Therefore it is necessary to measure the volume of fuel and air applied to the burner. This can be achieved by either volume or mass flow. Some large industrial water tube boilers also prefer fully metered combustion over the conventional parallel positioning.

The Autoflame fully metered cross-limited control system allows this to be done within an unlockable feature in the Mk8 MM Controller, avoiding the need for costly Programmable Logic Controllers. (A PLC also requires customised logic to perform the safety and control functions that have been included with the Mk8.) The Mk8 MM Controllers provides a safer, more reliable and more cost effective solution, with the added advantage of fully redundant operation.

Direct Modbus/BMS Connectivity

Connect to a Building Management System and through that the internet withou the use of a DTI.




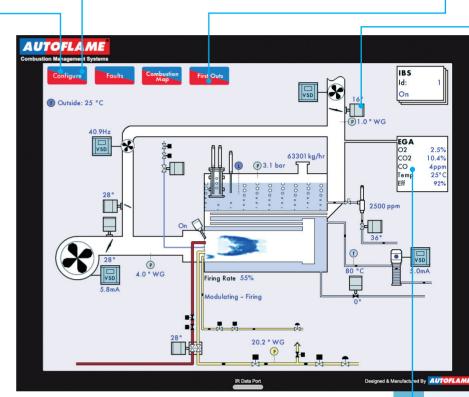

Conditional Fault Response

AUTOFLAME

For a large kiln, dryer or furnace application, one Controller can be configured as a Master with up to 9 Slave Controllers. This can be configured with Conditional Fault Response. For example, if a fuel flow meter for one of the burners becomes disabled, that burner can be disabled, or it can be set to run at commissioned levels. Either way, the remaining burners can be configured to observe the variance in fuel flow and compensate for the disruption. This means that the application can continue to provide the required heat until a convenient maintenance interval is available.

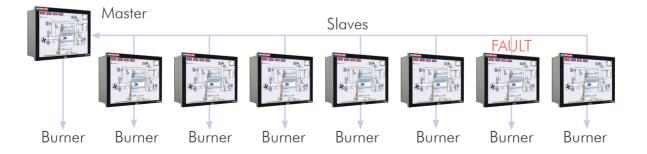

Ideally suited for industrial dryer, furnace and kiln applications.

• First Out Annunciation

The Mk8 can monitor non-Autoflame thermostats & switches with the First Out Annunciation system. For up to 15 inputs in a series control circuit, the first input that changes state will register as "fail" in the Mk8. **NEW**: Custom-label each input onscreen for easier identification.


Draft Control


Problem: Both heat transfer and combustion depend on the motion of flue gases. If stack pressure is not optimal, these gases will exit the flue too quickly (wasting heat) or too slowly (causing unstable flame, poor combustion, dangerous unburned fuel). A tall stack is more susceptible to a changing pressure due to stack temperature or wind velocity.

Solution: Draft control manages the draft from stacks to optimise heat transfer from the hot gases to the boiler tubes. A sensor in the stack monitors pressure. A damper modulates to increase or decrease flue gas flow based on commissioned pressure targets.

Key benefits:

- Improves heat transfer
- Improves combustion efficiency
- Reduces ambient boiler heat loss
- Improves flame retention
- Reduces soot accumulation

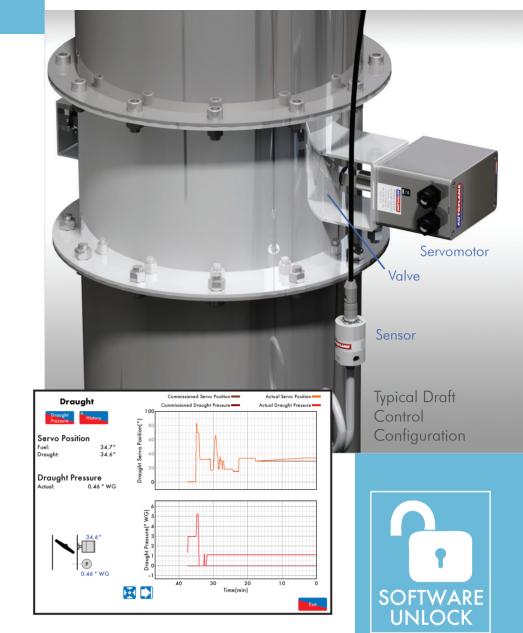

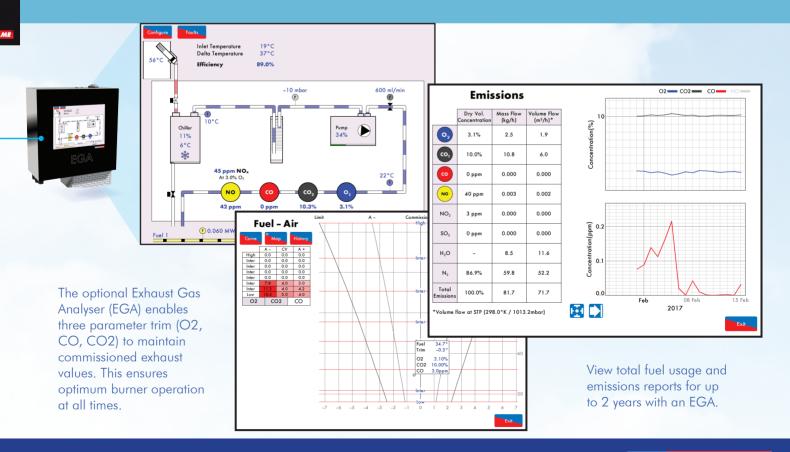

The Mini Mk8 is ideal for budget applications focused mainly on burner control.

The Mk8 MM offers expandability and is focused on complete boiler control.



	System Parts No. Annual 2002 - State Ker	
Standard Features	Mini Mk8 MM Controller	Mk8 MM Controller
Screen size	7" (14x10.7cm)	12.1" (24.5x18.5cm)
Touchscreen	Single-touch resistive	Multi-touch capactive
Flame safeguard	\checkmark	\checkmark
Air/fuel ratio control	\checkmark	\checkmark
IBS/lead-lag sequencing	\checkmark	\checkmark
Scheduling	\checkmark	\checkmark
Commissioning	\checkmark	\checkmark
VSD management	\checkmark	\checkmark
Reporting/graphing	\checkmark	\checkmark
FGR (Flue Gas Recirculation)	\checkmark	\checkmark
Channels	3 servos/1 VSD	4 servos/2 VSD 5th servo via access code
Lockout/error logging	Most recent 64 errors/lockouts	Most recent 128 errors/lockouts
Number of fuel curves	2	4
VPS (Gas Valve Proving)	\checkmark	\checkmark
Outside temperature	\checkmark	\checkmark
Login security	\checkmark	\checkmark
Back up commissioning data via IR port	\checkmark	\checkmark
Boiler log entries	1000	1000
Dual fuel support	\checkmark	\checkmark
Air pressure monitoring & proving	\checkmark	\checkmark
Oil pressure monitoring	_	\checkmark
Fuel flow metering	\checkmark	\checkmark
Golden start facility	\checkmark	\checkmark
Commisioning points	20	20
Customizable graphics	\checkmark	\checkmark
Flame rod/UV change over option	\checkmark	\checkmark
Multi-language display	\checkmark	\checkmark
Metric/Imperial	\checkmark	\checkmark
UL, CE, AGA approvals	\checkmark	\checkmark
On-board technical manual	\checkmark	\checkmark

Available with software access code		\frown	
Direct Modbus connectivity	√*	✓	1
Autoflame Water Level Management (AF WLM)	-	✓ SOFT	
Analogue water level management (requires AF WLM)	-	✓ UNL	OCK
Steam/heat flow metering	-	\checkmark	
Top blowdown/TDS	-	\checkmark	
Bottom blowdown	-	\checkmark	
Draft control	-	\checkmark	
First out annunciation	-	\checkmark	
Fully metered, cross-limited combustion control	-	\checkmark	עכ
*Mini Mk8 does not require access code		(bsi. VKAS UKAS UKAS

Requires additional module or componer LISTED Requires DTI Requires DTI Indirect Modbus connectivity O2 trim Requires O2 Module Requires O2 Module Three parameter trim (O2, CO2, CO) **Requires EGA** Requires EGA Emissions monitoring & reporting Requires EGA Requires EGA






Remote monitoring, control & data storage

Data Transfer Interface (DTI)

- View live streaming data of up to 10 boilers from a single DTI, through a local PC or BMS
- Enables BMS integration with the boiler plant via MODBUS and Ethernet
- View up to 1000 items of information from each MM Controller and each EGA
- Stores up to 2 years of data history on all boilers

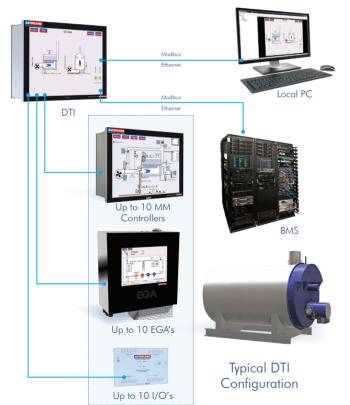

Mk8 EGA EVO



Enable trim & emissions monitoring/auditing Exhaust Gas Analyser (EGA)

- Enables 3 parameter trim on Mk8 MM Controller for improved burning efficiency.
- Continuous Emissions Monitoring System (CEMS) for display & data trending. View reports by user-definable time periods (6 hours, 8 days, 500 days, etc.) based on:
 - Total weight & volumetric emissions
 - Total cost of fuel (calculated by current cost per tonne of fuel)
 - Weight & volumetric emissions per exhaust gas (O₂, CO₂, CO, NO, NO₂, SO₂) & per fuel
 - Specifically designed for current regulations on emissions monitoring
- MM Controller or Standalone Operation modes
- Six 4-20mA analogue outputs of all combustion data for remote logging, printing or chart recording
- Automated cell calibrations on bottled calibration gas (EPA version of EGA)

Custom Panels

Our in-house custom manufactured panels are usually the lowest cost, highest quality option. This is because we can engineer it with the MM Controller and other accessories to customer requirements, creating a complete factory solution that offers:

- Seamless integration of controller and all electrical
- Complete quality control overseen by our engineers
- Faster installation of a single finished unit instead of multiple components





Ancillary Equipment

Autoflame manufactures to the highest quality standards a range of servomotors, probes, scanners, sensors, valves and other parts to support its burner/boiler management system. These are all designed and manufactured in house to maintain the highest quality control.

Local Installation & Support

Autoflame has partnerships with more than 95 Technology Centres worldwide. To maintain our reputation for quality, safety and reliability, Autoflame ensures they receive regular training to keep up to date with our latest innovations.

About Autoflame

Founded in 1972, Autoflame is a world leader in boiler/ burner management systems for both commercial and industrial applications. Based near London, England, it ensures industry-leading quality control and innovation by performing in-house R&D, engineering, software development, manufacturing production, and technical support.

Privately owned by its founder, Brendan Kemp, Autoflame currently has more than 10,000 systems in operation globally, and is now specified as standard equipment in some of the world's most prestigious organisations.

Autoflame patents related to Boiler Automation, Efficiency & Safety

Europe: 1022515, 1373796, 1384944, 1384945, 1384946, 60014980.3, 60201594.4, 60202855.8, 60203002.1, 60203040.4, 09252836.3, 11778663.2, 1022515, 10151584.9

UK: 1022515, 1373796, 1384944, 1384945, 1384946, 2412958, 2448624, 2448625, 0823303, 3, 0907125.9, 1018178.2, 1214740.1, 1318174.8, 0907125.9, 1018178.2

USA: 6024561, 6520122, 6978741, 12/946,615, 6024561, 7249573, 13/591922, 13/651029 Canada: 2295458

